


# ANEMOSTAT<sup>®</sup>


AIR TERMINAL CONTROLS

## Control Package SD - D - 7000A

- SINGLE DUCT
- BACNET DIGITAL CONTROLS
- VAV COOLING ONLY
- PRESSURE INDEPENDENT
- NETSENSOR ABC-1161/1161W

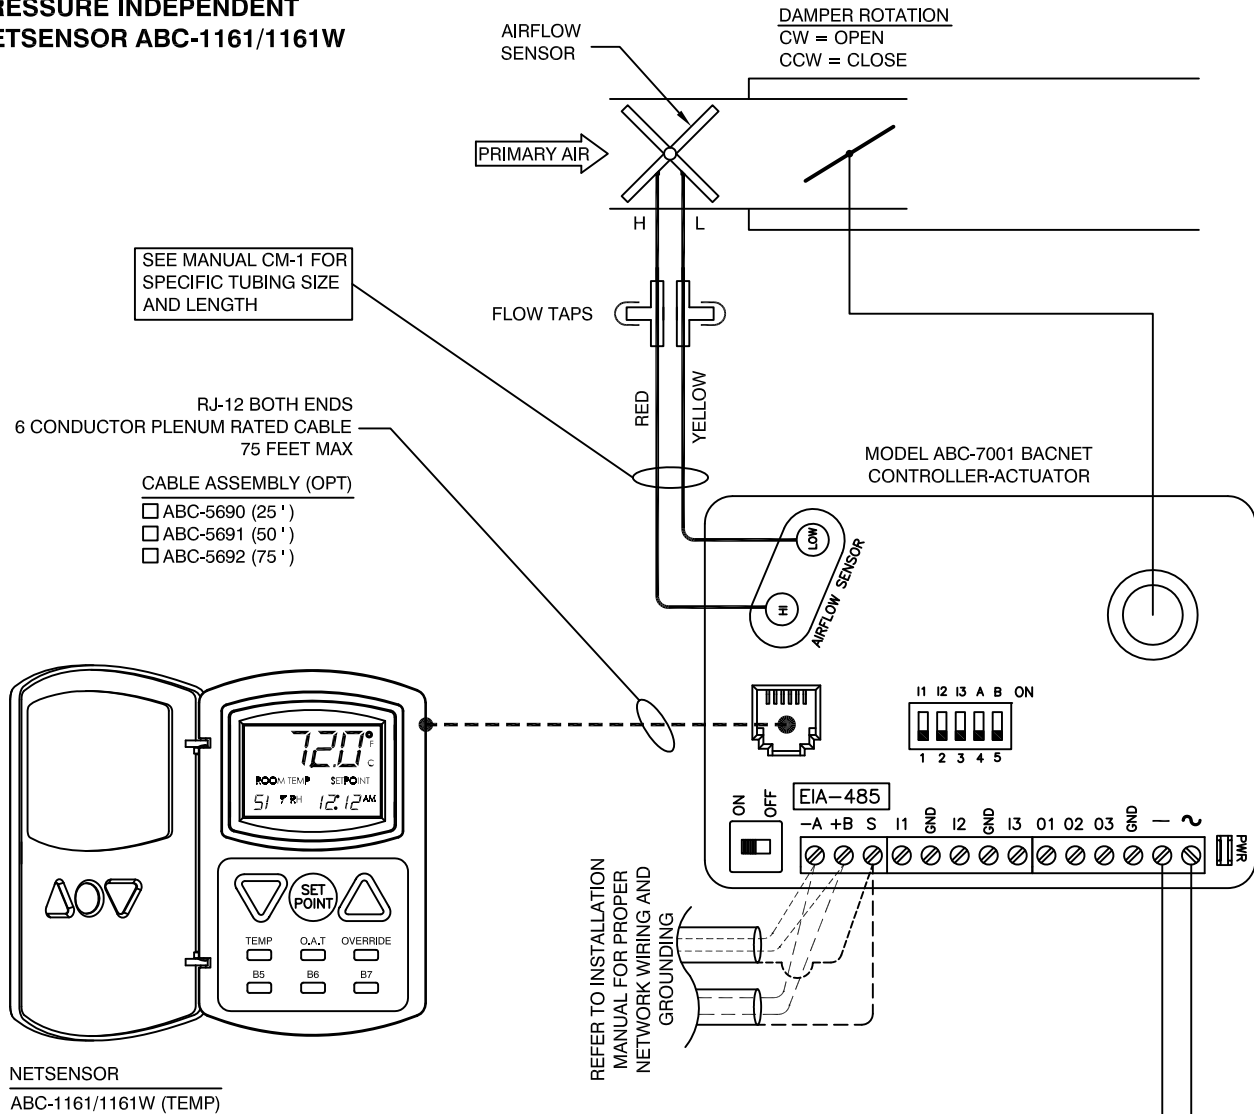

NETSENSOR  
ABC-1161/1161W (TEMP)

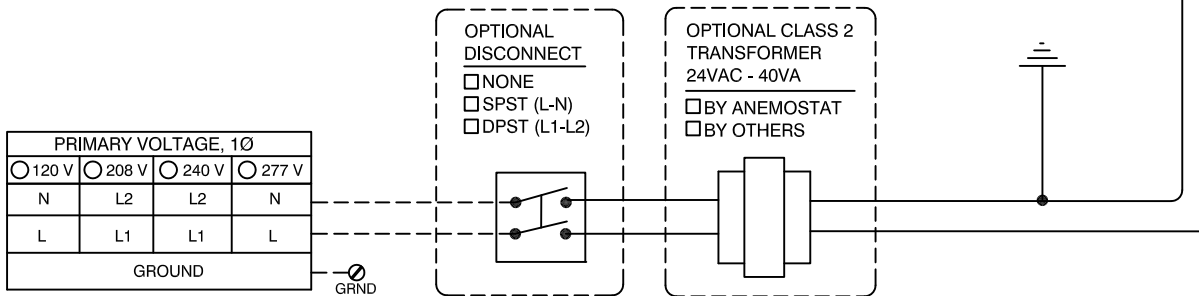

\_\_\_\_\_ FACTORY WIRING  
 - - - - - FIELD WIRING  
 \_\_\_\_\_ FACTORY PIPING

REFER TO ANEMOSTAT "CONTROLS MANUAL" (CM-1) FOR ADJUSTMENT & TROUBLESHOOTING PROCEDURES.

**JOB NAME:**  
**SUBMITTED BY:**  
**DATE:**

**DWG #:** SD-D-7000A.1  
**REV:** E  
**DATE:** 1-2-14