


# ANEMOSTAT<sup>®</sup>

## AIR TERMINAL CONTROLS

Control Package  
**SD - D - 7004A**

- SINGLE DUCT, VAV COOLING
- BACNET DIGITAL CONTROLS
- ELECTRIC HEAT - STEP CONTROL (SCR SIMULATED)
- PRESSURE INDEPENDENT
- NETSENSOR ABC-1161/1161W

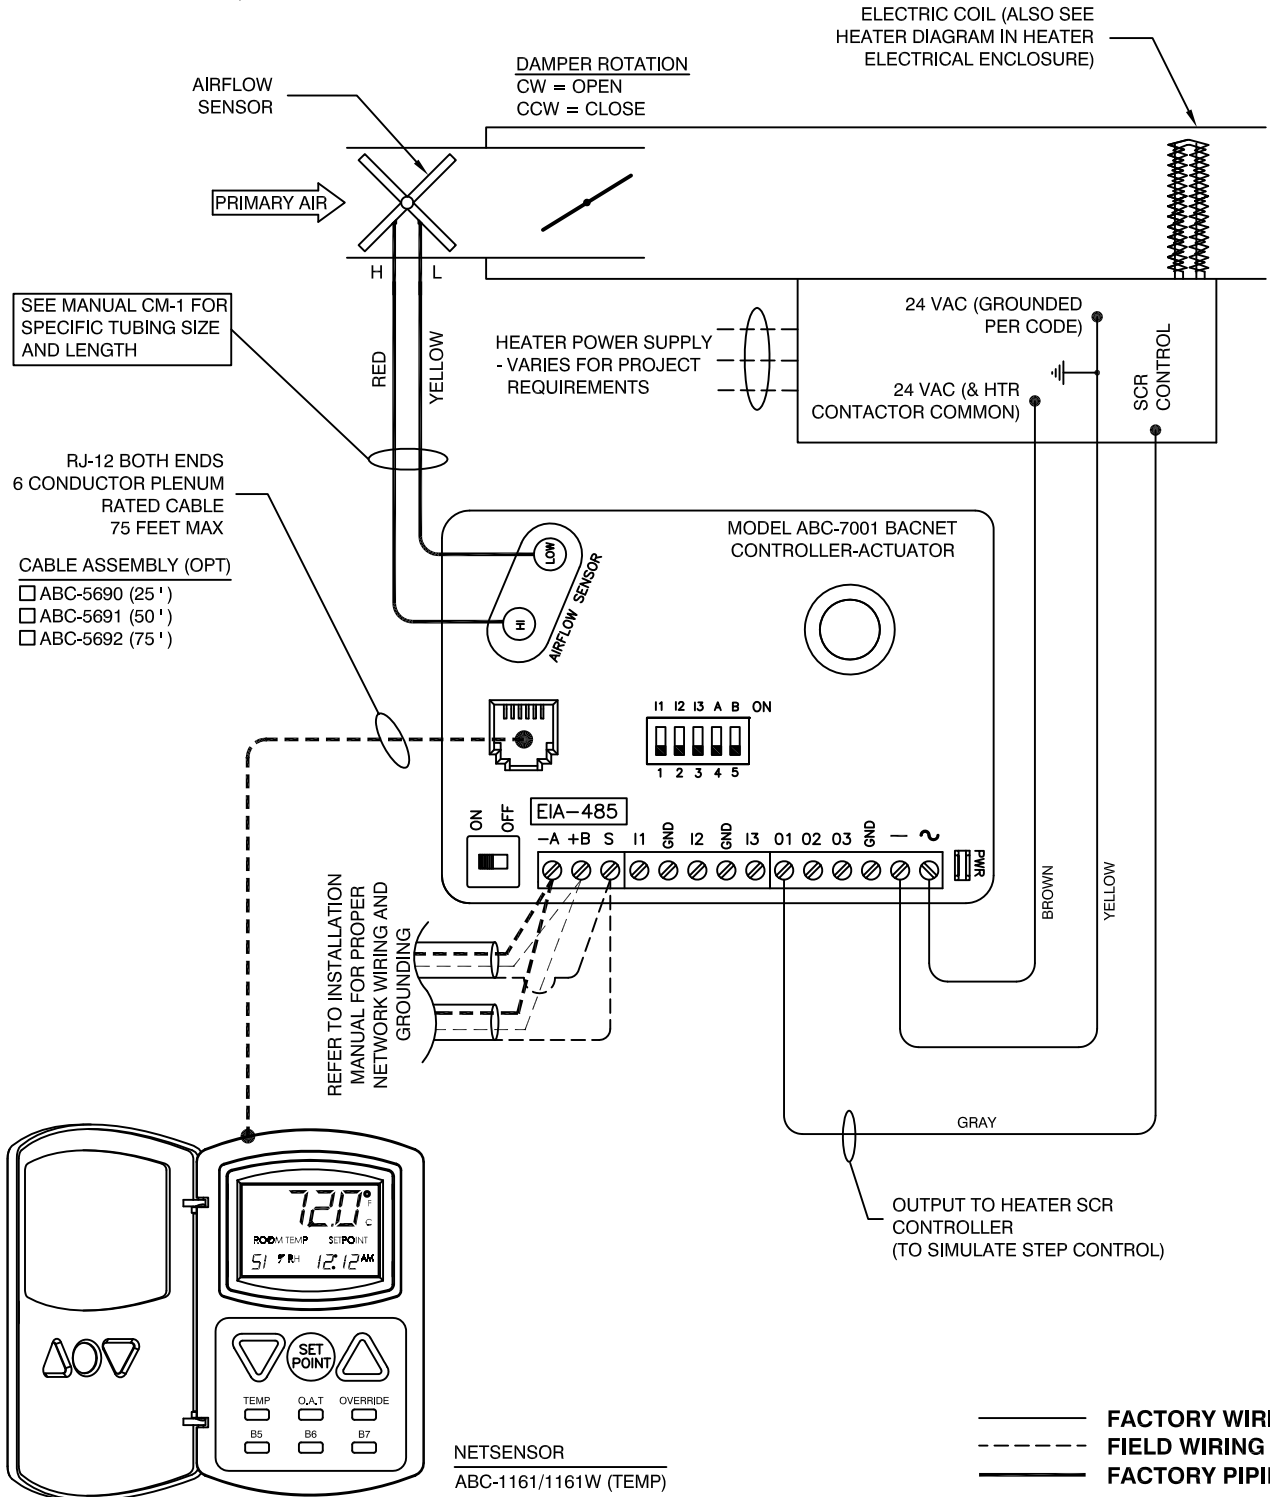

SEE MANUAL CM-1 FOR SPECIFIC TUBING SIZE AND LENGTH

RJ-12 BOTH ENDS  
6 CONDUCTOR PLENUM  
RATED CABLE  
75 FEET MAX

- CABLE ASSEMBLY (OPT)
- ABC-5690 (25')
  - ABC-5691 (50')
  - ABC-5692 (75')

REFER TO INSTALLATION MANUAL FOR PROPER NETWORK WIRING AND GROUNDING

OUTPUT TO HEATER SCR CONTROLLER (TO SIMULATE STEP CONTROL)

**JOB NAME:**  
**SUBMITTED BY:**  
**DATE:**

**DWG #: SD-D-7004A.1**  
**REV: -**  
**DATE: 2-27-13**