

Anemostat® SUBMITTAL


1220 Watson Center Road • Carson, CA 90745-4206
(310) 835-7500 • FAX (310) 835-0448
air@anemostat.com • www.anemostat.com

LIGHT ALERT FILTER MONITORING SYSTEM TYPICAL WIRING DIAGRAM FOR HEPA FILTERED PRODUCTS STANDALONE


DIRECT DIGITAL CONTROLS

- MODEL LA-24
POWER SUPPLY (OPTIONAL)
NOTE: C LEG OF 24VAC TRANSFORMER
IS GROUNDING


POWER IN
 120V /Ø1
 208V /Ø1
 240V /Ø1
 277V /Ø1

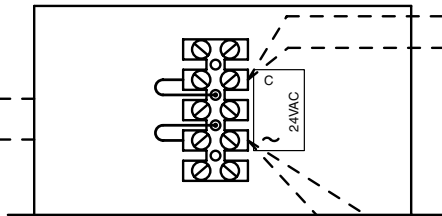


FILTER MODULE
W/ LIGHT ALERT FEATURE

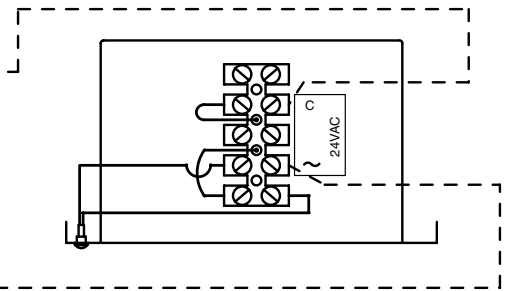

FILTER MODULE
W/ LIGHT ALERT FEATURE

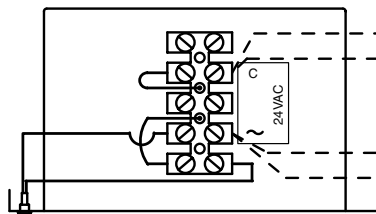

FILTER MODULE
W/ LIGHT ALERT FEATURE

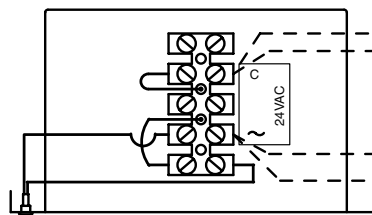

TO OTHER
FILTER
MODULES

----- FIELD WIRING
 _____ FACTORY WIRING

All dimensions are in inches.

JOB NAME:

SUBMITTED BY: