


Control Package

SD - P - 3460

- SINGLE DUCT
- PNEUMATIC CONTROLS
- VAV COOLING
- DUAL MAX & HOT WATER HEAT
- PRESSURE INDEPENDENT
- REVERSE ACTING THERMOSTAT
- NORMALLY CLOSED DAMPER

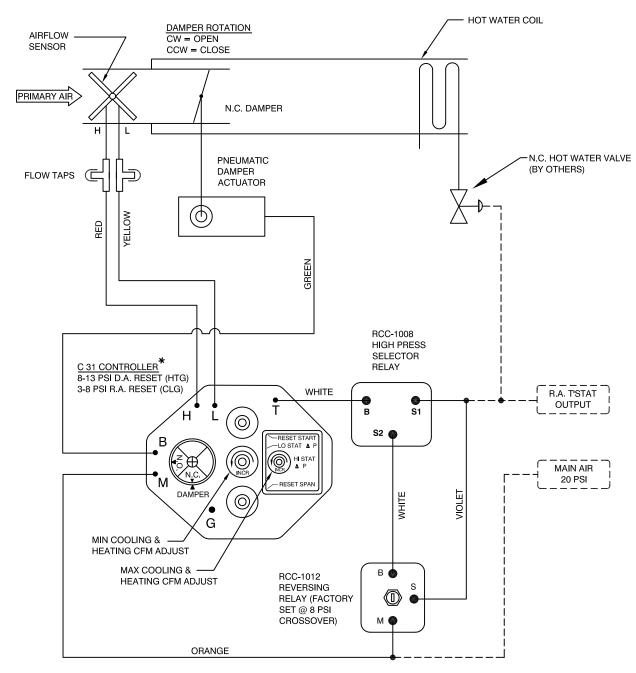

FACTORY PIPING

---- FIELD PIPING

\* NOTE: CONTROLLER SETUP IS 8-13 DA

REFER TO ANEMOSTAT "CONTROLS MANUAL" (CM-1) FOR ADJUSTMENT & TROUBLESHOOTING PROCEDURES.

JOB NAME: SUBMITTED BY:

DATE:

DWG #: SD-P-3460.1

REV: -

DATE: 1-9-08